



Zennergy

Measurement & Savings Verification

Georgia Steakhouse Restaurant


17.90% Decrease in Average Daily Consumption (Month VS Month)

Since installing (1) 1" Flow Management Device with Zennergy LLC, on 3/20/16 the property has realized an 17.9% decrease in average daily water consumption when comparing August and Sept. of 2015 to the same months of 2016. The post installation water consumption from March through July has been excluded due to a leak that was discovered.

Average Daily Gallons
(month vs month)



Pre & Post Installation

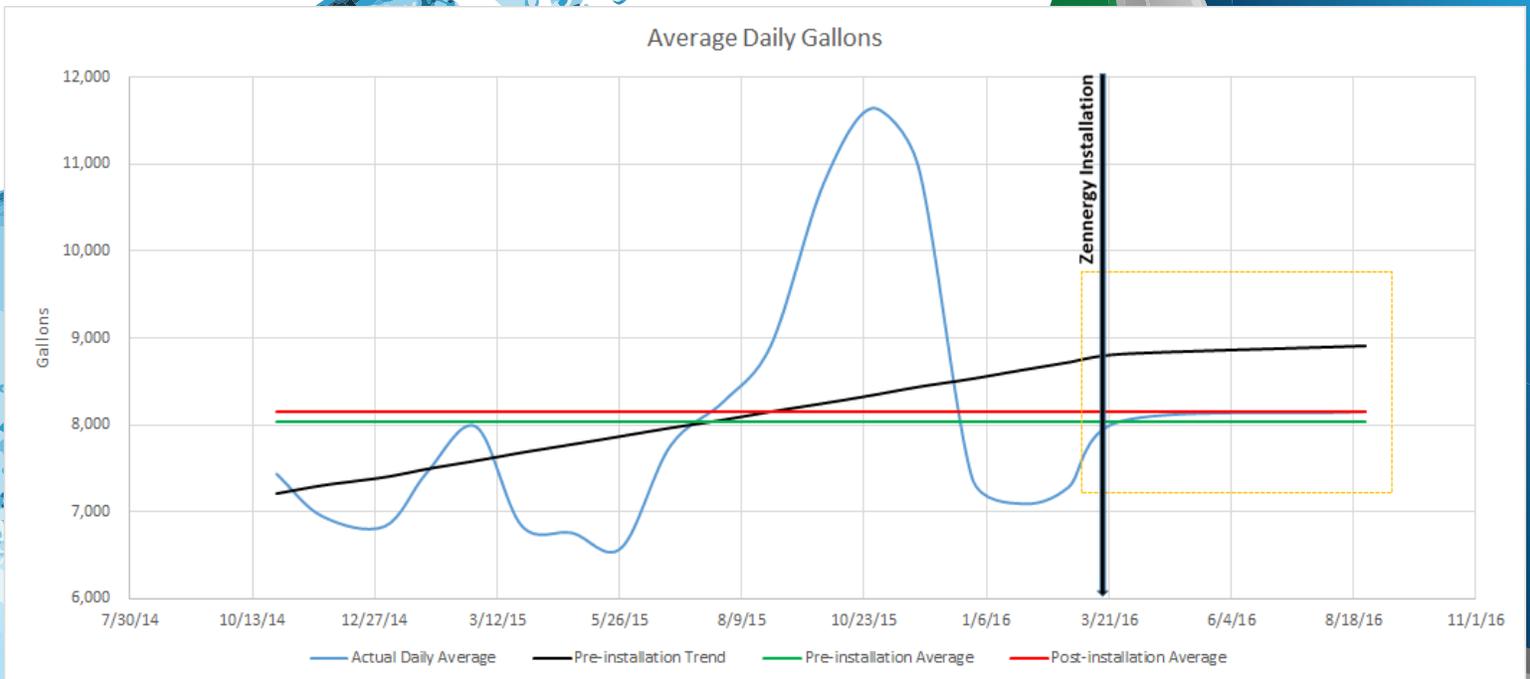



Zenenergy

Measurement & Savings Verification

Raw Data

Steakhouse Restaurant Georgia										
Bill	Start Date	End Date	Days	\$ Water	\$ Sewer	\$ TOTAL	UOM	GALLONS	Daily Average	
1	9/25/2014	10/28/2014	33	\$ 2,007.28	\$ 5,122.32	\$ 7,129.60	328	245,344.00	7,434.67	
2	10/28/2014	11/25/2014	28	\$ 1,588.40	\$ 4,055.40	\$ 5,643.80	260	194,480.00	6,945.71	
3	11/25/2014	1/2/2015	38	\$ 2,124.32	\$ 5,420.43	\$ 7,544.75	347	259,556.00	6,830.42	
4	1/2/2015	1/28/2015	26	\$ 1,582.24	\$ 4,039.71	\$ 5,621.95	259	193,732.00	7,451.23	
5	1/28/2015	2/27/2015	30	\$ 1,958.00	\$ 4,996.80	\$ 6,954.80	320	239,360.00	7,978.67	
6	2/27/2015	3/27/2015	28	\$ 1,563.76	\$ 3,992.64	\$ 5,556.40	256	191,488.00	6,838.86	
7	3/27/2015	4/27/2015	31	\$ 1,711.60	\$ 4,369.20	\$ 6,080.80	280	209,440.00	6,756.13	
8	4/27/2015	5/27/2015	30	\$ 1,613.04	\$ 4,118.16	\$ 5,731.20	264	197,472.00	6,582.40	
9	5/27/2015	6/26/2015	30	\$ 1,902.56	\$ 4,855.59	\$ 6,758.15	311	232,628.00	7,754.27	
10	6/26/2015	7/29/2015	33	\$ 2,235.20	\$ 5,702.85	\$ 7,938.05	365	273,020.00	8,273.33	
11	7/29/2015	8/27/2015	29	\$ 2,118.16	\$ 5,404.74	\$ 7,522.90	346	258,808.00	8,924.41	
12	8/27/2015	9/28/2015	32	\$ 2,826.56	\$ 7,218.09	\$ 10,044.65	461	344,828.00	10,775.88	
13	9/28/2015	10/28/2015	30	\$ 2,863.52	\$ 7,303.23	\$ 10,166.75	467	349,316.00	11,643.87	
14	10/28/2015	11/25/2015	28	\$ 2,525.12	\$ 5,431.15	\$ 7,956.27	411	307,428.00	10,979.57	
15	11/25/2015	12/28/2015	33	\$ 2,001.52	\$ 5,097.50	\$ 7,099.02	326	243,848.00	7,389.33	
16	12/28/2015	1/26/2016	29	\$ 1,680.80	\$ 4,290.75	\$ 5,971.55	275	205,700.00	7,093.10	
17	1/26/2016	2/25/2016	30	\$ 1,785.52	\$ 4,557.48	\$ 6,343.00	292	218,416.00	7,280.53	
18	2/25/2016	3/28/2016	32	\$ 2,105.84	\$ 5,373.36	\$ 7,479.20	344	257,312.00	8,041.00	
Totals			550			\$ 127,542.84	5,912.00	4,422,176.00		
Averages						\$ 7,085.71		245,676.44	8,054.08	
Install Date 3/20/16										
Leak (excluded)	19	3/28/2016	4/27/2016	30	\$ 2,075.44	\$ 5,285.78	\$ 7,361.22	338	252,824.00	8,427.47
Leak (excluded)	20	4/27/2016	5/26/2016	29	\$ 2,062.72	\$ 5,263.53	\$ 7,326.25	337	252,076.00	8,692.28
Leak (excluded)	21	Missing	Missing	#VALUE!		\$ -		-	#VALUE!	
Leak (excluded)	22	Missing	Missing	#VALUE!		\$ -		-	#VALUE!	
Leak Fixed (included)	23	7/27/2016	8/25/2016	29	\$ 1,933.36	\$ 4,934.04	\$ 6,867.40	316	236,368.00	8,150.62
Leak Fixed (included)	24	8/25/2016	9/27/2016	33	\$ 2,167.44	\$ 5,530.26	\$ 7,697.70	354	264,792.00	8,024.00
	25			0		\$ -		-	#DIV/0!	
	26			0		\$ -		-	#DIV/0!	
	27			0		\$ -		-	#DIV/0!	
	28			0		\$ -		-	#DIV/0!	
	29			0		\$ -		-	#DIV/0!	
Totals			62			\$ 14,565.10	670	501,160.00		
Averages			31			\$ 7,282.55	335	250,580.00	8,087.31	
Savings %									-0.41%	

Month VS Month

Steakhouse Restaurant Georgia										
Bill	Start Date	End Date	Days	\$ Water	\$ Sewer	\$ TOTAL	UOM	GALLONS	Daily Average	
11	7/29/2015	8/27/2015	29	\$ 2,118.16	\$ 5,404.74	\$ 7,522.90	346.00	258,808.00	8,924.41	
12	8/27/2015	9/28/2015	32	\$ 2,826.56	\$ 7,218.09	\$ 10,044.65	461.00	344,828.00	10,775.88	
Totals			61			\$ 17,567.55	807.00	603,636.00		
Averages						8,783.78		301,818.00	9,850	
Install Date 3/20/16										
Leak Fixed	23	7/27/2016	8/25/2016	29	\$ 1,933.36	\$ 4,934.04	\$ 6,867.40	316.00	236,368.00	8,150.62
Leak Fixed	24	8/25/2016	9/27/2016	33	\$ 2,167.44	\$ 5,530.26	\$ 7,697.70	354.00	264,792.00	8,024.00
Totals			62			\$ 14,565.10	670.00	501,160.00		
Averages						\$ 7,282.55		250,580.00	8,087	
Savings %						17.09%			17.90%	