

# Measurement & Savings Verification


## Zenenergy

### 13 Floor Apartment Building




Since installing (1) 4" Flow Management Device with Zenenergy LLC, on March 24th 2016, the property has realized a 8.89% reduction in daily average water consumption compared to the 12 months prior to installation. When comparing 3/17/15 - 7/15/15 vs 3/22/16 - 7/12/16 there has been a 15.14% reduction in water consumption.

### Average Daily Water Usage

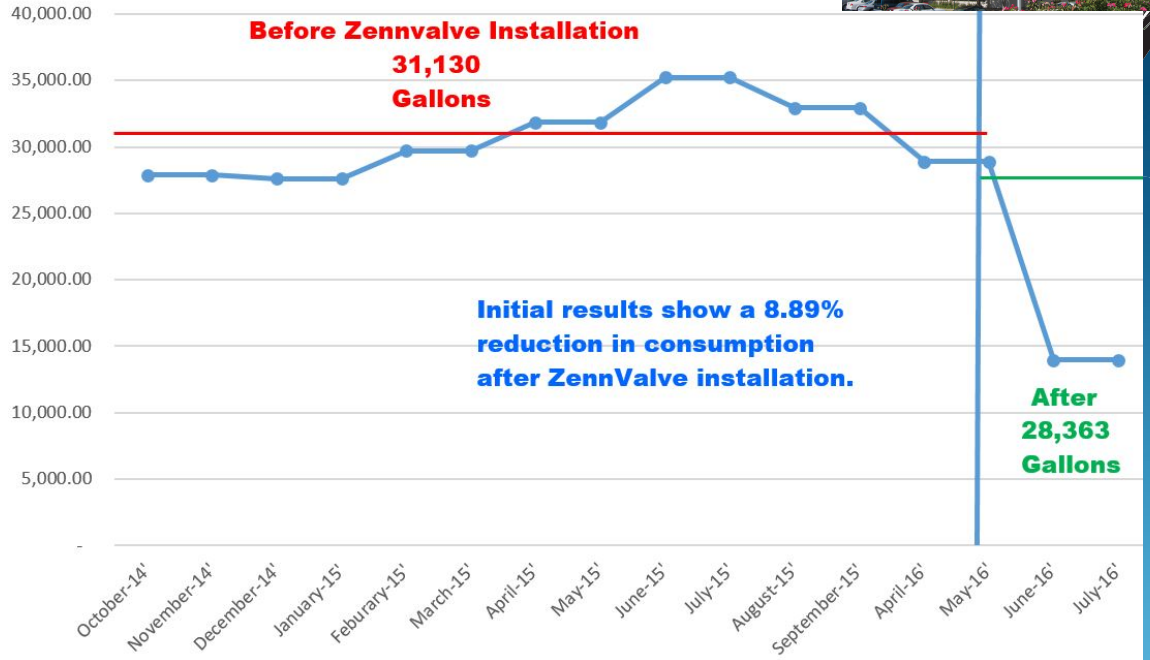

## 15.14% Reduction in Daily Average Water Consumption

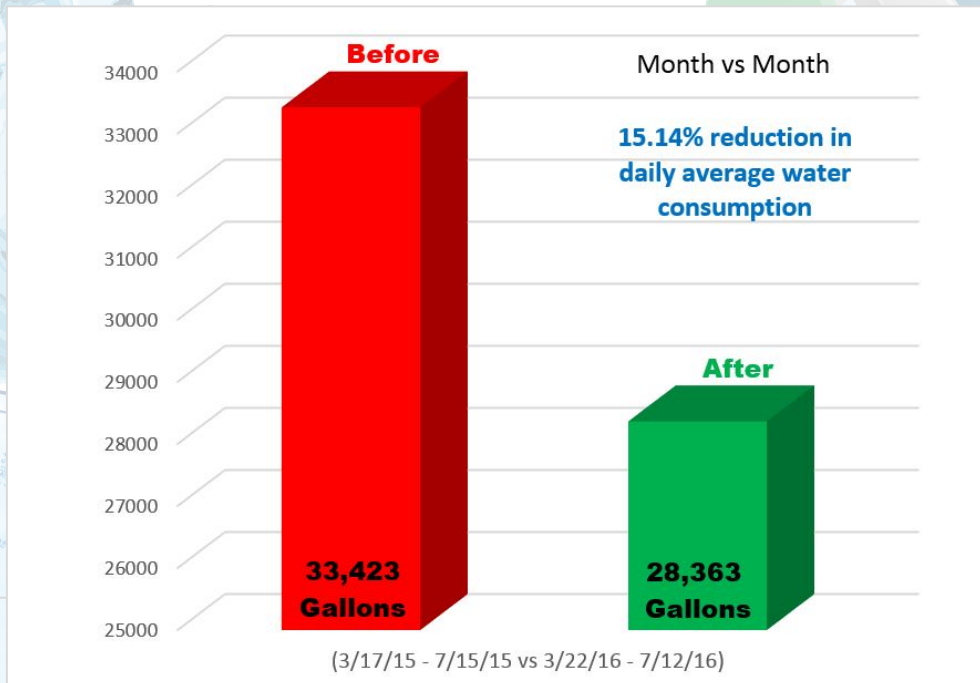

Account #102033		Bill	Start Date	End Date	Days	Days	\$ Water	\$ Sewer	\$ TOTAL	\$ TOTAL Monthly	UOM	Gallons	Gallons Monthly	Daily Average	Daily Average Difference	% Change	Gallons Difference	% Change	\$ Total Difference	% Change	
Meter #Needs to be confirmed	3"	1,2	10/13/2014	12/10/2014	58	29	\$ 6,491.30	\$ 10,307.10	\$ 16,798.40	\$ 8,399.20	2161	1,616,428.00	808,214.00	27,869.45							
		3	12/10/2014	1/13/2015	34	34	\$ 3,922.43	\$ 5,985.85	\$ 9,908.28	\$ 9,908.28	1255	938,740.00	938,740.00	27,610.00	(259.45)	0.93	130,526.00	(16.15)	\$ (6,890.12)	41.02	
Commercial		4,5	1/13/2015	3/17/2015	63	31.5	\$ 7,458.17	\$ 11,933.54	\$ 19,391.71	\$ 9,695.86	2502	1,871,496.00	935,748.00	29,706.29	2,096.29	(7.59)	(2,992.00)	0.32	\$ 9,483.43	-95.71	
		6,7	3/17/2015	5/20/2015	64	32	\$ 8,087.63	\$ 12,992.39	\$ 21,080.02	\$ 10,540.01	2724	2,037,552.00	1,018,776.00	31,836.75	2,130.46	(7.17)	83,028.00	(8.87)	\$ 1,688.31	-8.71	
		8,9	5/20/2015	7/15/2015	56	28	\$ 7,595.82	\$ 12,203.12	\$ 19,798.94	\$ 9,899.47	2638	1,973,224.00	986,612.00	35,236.14	3,399.39	(10.68)	(32,164.00)	3.16	\$ (1,281.08)	6.08	
		10,11	7/15/2015	9/21/2015	68	34	\$ 8,574.49	\$ 13,854.57	\$ 22,429.06	\$ 11,214.53	2995	2,240,260.00	1,120,130.00	32,945.00	(2,291.14)	6.50	133,518.00	(13.53)	\$ 2,630.12	-13.28	
Totals					343				\$ 109,406.41		14,275.00	10,677,700.00		31,130.32							
Averages															(3.60)						
<b>Install Date 3/24/2016</b>																					
		12,13	3/22/2016	5/10/2016	49	24.5	\$ 5,550.72	\$ 8,752.20	\$ 14,302.92	\$ 7,151.46	1892	1,415,216.00	707,608.00	28,881.96							
		14,15	5/11/2016	7/12/2016	62	31	\$ 6,715.83	\$ 10,718.21	\$ 17,434.04	\$ 8,717.02	2317	1,733,116.00	866,558.00	13,976.74	(14,905.22)	51.60736	158,950.00	(22.46)	\$ 3,131.12	-21.89	
		15			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!	(866,558.00)	100.00	\$ (17,434.04)	100.00	
		16			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
		17			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
		18			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
		19			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
		20			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
		21			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
		22			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
		23			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
		24			0	0			\$ -	\$ -					#DIV/0!	#DIV/0!			\$ -	#DIV/0!	
Totals					111				\$ 31,736.96		4,209.00	3,148,332.00		28,363.35							
Averages																					
Savings %																				8.89%	

Account #102033		Bill	Start Date	End Date	Days	Days	\$ Water	\$ Sewer	\$ TOTAL	\$ TOTAL Monthly	UOM	Gallons	Gallons Monthly	Daily Average	Daily Average Difference	% Change	Gallons Difference	% Change	\$ Total Difference	% Change
Meter #Needs to be confirmed	3"	6,7	3/17/2015	5/20/2015	64	32	\$ 8,087.63	\$ 12,992.39	\$ 21,080.02	\$ 10,540.01	2724	2,037,552.00	1,018,776.00	31,836.75	#REF!	#REF!	#REF!	#REF!	#REF!	#REF!
		8,9	5/20/2015	7/15/2015	56	28	\$ 7,595.82	\$ 12,203.12	\$ 19,798.94	\$ 9,899.47	2638	1,973,224.00	986,612.00	35,236.14	3,399.39	(10.68)	(32,164.00)	3.16	\$ (1,281.08)	6.08
Commercial					120				\$ 40,878.96		5,362.00	4,010,776.00		33,423.13						
Averages															#REF!					
<b>Install Date</b>																				
		12,13	3/22/2016	5/10/2016	49	24.5	\$ 5,550.72	\$ 8,752.20	\$ 14,302.92	\$ 7,151.46	1892	1,415,216.00	707,608.00	28,881.96						
		14,15	5/11/2016	7/12/2016	62	31	\$ 6,715.83	\$ 10,718.21	\$ 17,434.04	\$ 8,717.02	2317	1,733,116.00	866,558.00	13,976.74	(14,905.22)	51.60736	158,950.00	(22.46)	\$ 3,131.12	-21.89
Totals					111				\$ 31,736.96		4,209.00	3,148,332.00		28,363.35						
Averages																				
Savings %																				15.14

Since installing (1) 3" Flow Management Device with Zenenergy LLC, on March 24th 2016, the property has realized a 15.14% reduction in daily average water consumption when comparing the months of March - July 2015 (pre-installation) vs March - July 2016.