


**Zennergy**

# Measurement & Savings Verification

Commercial Laundry Service

## 14.83% Reduction in Daily Average Consumption (June - Aug 2015 vs June - Aug 2016)

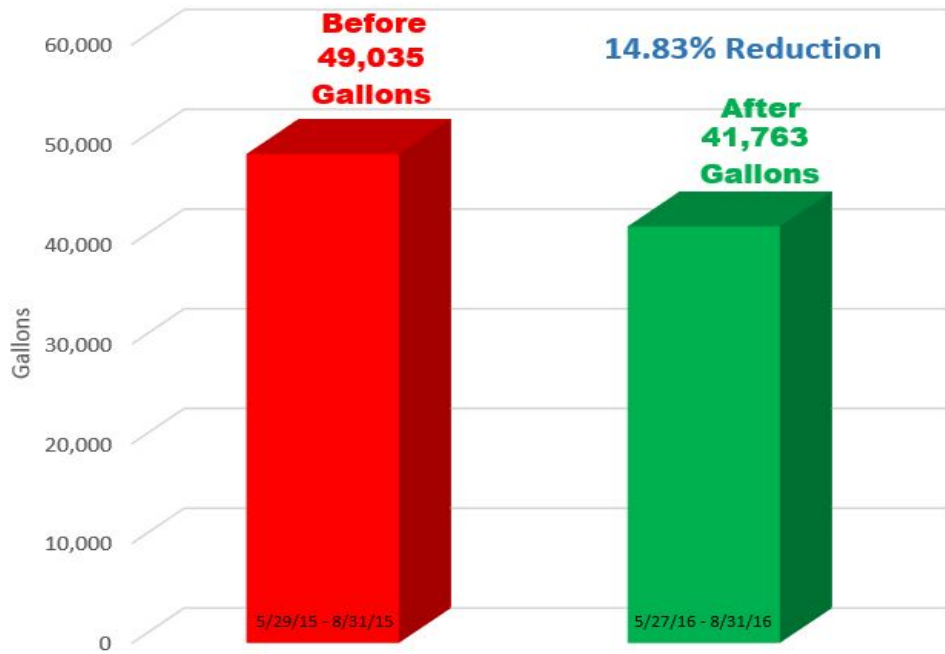

Since installing (1) 4" Flow Management Device with Zennergy LLC, on May 21st 2016 the property has realized a 14.83% decrease in the daily average water consumption for the months of June - Aug 2016 compared to June - Aug 2015. Additionally, the property has seen a 6.40% reduction in daily average water consumption compared to the 17 month pre-installation daily average from November 2014 through May 2016.

## 6.04% Reduction in Daily Average Consumption

### Average Daily Water Usage

